


/ 2019-06-17 09:22:36 / China / 8901 / EN



90.92 kWhpe/m².

(:)

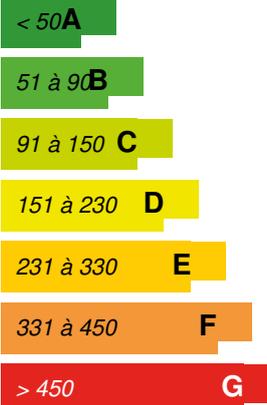

:

: 2013

: 2017

1- : 184 518000 ,

: [Dfb]

: 89 688 m² Other

/ : 1 416 960 ¥

/m² : 15.8 ¥/ m²



	8+9A+8		24211.2kwh
	800m ³	19053.10m ³	21.54%
	14.1%	10%	11.1%
25			



:
: 13662601019 zhangying@cohl.com
<http://www.coli688.com/>

:

15210560274 854624648@qq.com
<http://www.thupdi.com/>



“ ”

()

4

(1)

12000

(2)

10%

(3)

(4)

“ ”

1

10%

2

3

COP 6.06

50-100%

4

24000kWh

5

268GJ

6

7

2017

/

50-100%

,

CO2



: 90,92 kWhpe/m².

: 122,47 kWhpe/m².

:

: 58,40 kWhfe/m².

:

28.38 Kwh/m2/year

17.50 Kwh/m2/year

5.59 Kwh/m2/year

6.93 Kwh/m2/year

U : 0,52 W.m⁻².K⁻¹

:

140mm ()

50-100mm ()

+Low-E

: 0,07

/ : 58,20 kWhfe/m².

: 2 018



:

o

:

o

o

:

o

:

o

:

o

o

: 0,70

:

1

2



: 53,63 KgCO₂/m²/

:

CECS 374-2014

: 21,17 KgCO₂ /m²

: 50,00

, xx : 0.39

CECS 374-2014

LCA

CO₂

: 137 075 000,00 m³

m³ : 3 160,00 m³

: 3 160,00 m³

/m² : 1528.35

/ : 9453.45



32

<https://york.cn.gongchang.com/>

:

650KW 3516KW COP5.4

10% COP



255 4 1 A 6 021-23063000

<http://www.carrier.com.cn>

:

KW 2000 /



9

<http://www.syexny.com>

: HVAC /


0.95

30

1.2Mpa

3.2mm

89%

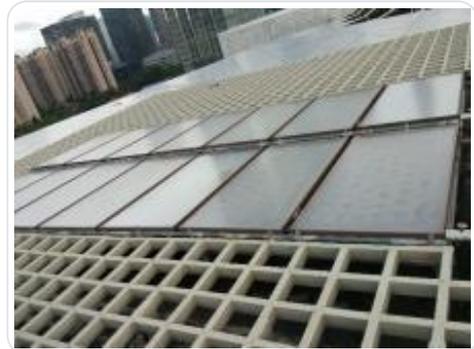

shwarm@shwarm.com

<http://www.shwarm.com>

: HVAC /

9.28KW

40KW

860L/h

55°C

CPU



<http://www.east-view.com.cn/>

: HVAC /



(

1688


<https://www2.g-u.com/>

:

DIN EN 12101-2

B 1

(
GU

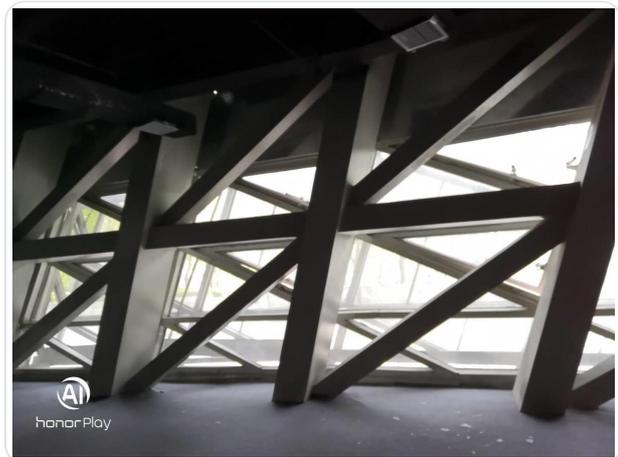

46 service@nanfang-pump.com

<http://www.nanfang-pump.com/>

:

4KW 900r/min 40m³/h



: 869 000,00 ¥

: 11 138 000 ¥

¥

/ : 6 106 000,00 ¥

t/m² : 68.08

/ : 421.1



400 60 3 4

: 29 688,40 m²

: 8 906,50

326




29688

58.6kWh/

10%

“ ”



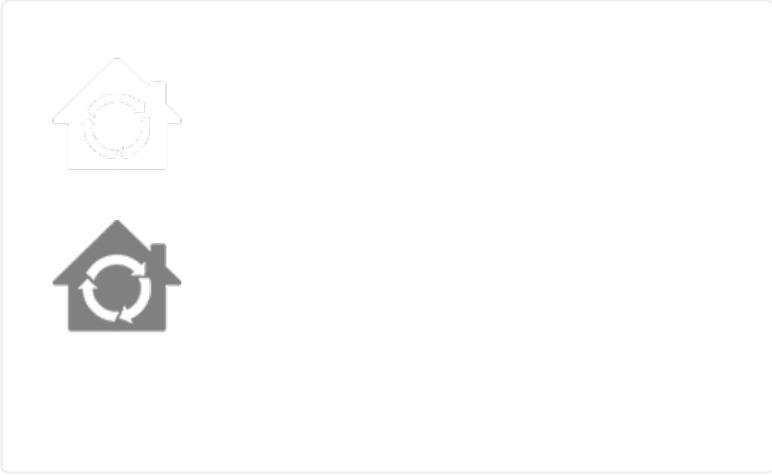

 PDF